


NOTE:  
 OPENINGS BETWEEN  
 EXISTING PIPE AND  
 NEWLY INSTALLED  
 DOGHOUSE MH SHALL  
 BE SEALED WITH  
 NON-SHRINK HYDRAULIC  
 CEMENT.

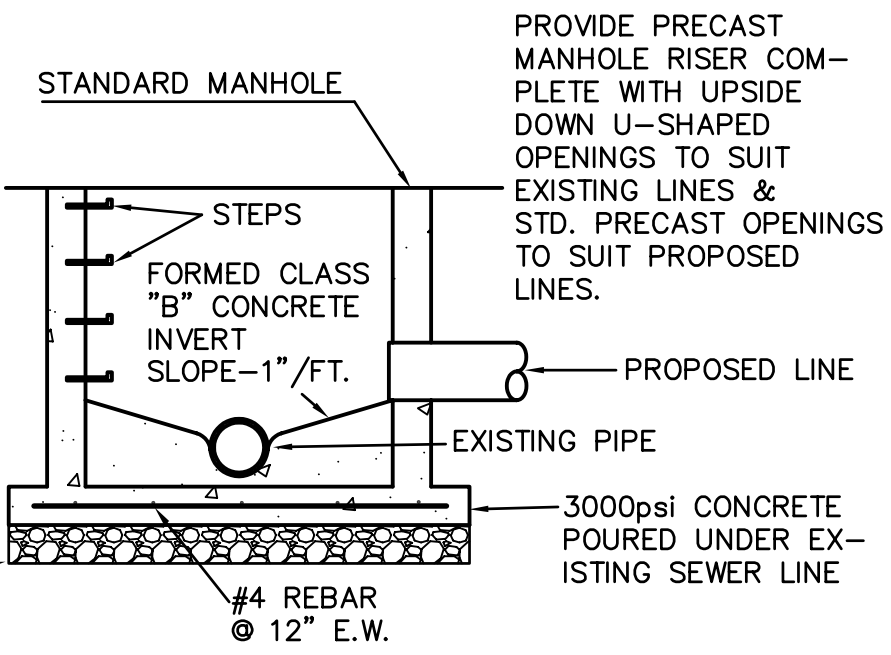

NOTE:  
 TABLES ARE TO BE  
 GENTLY SLOPED AND  
 TROWELED SMOOTH  
 FROM MANHOLE WALL  
 TO INVERT WALL HEIGHT  
 AND CONSTRUCTED OF  
 AGGREGATE-MIX CEMENT  
 WITH SMOOTH VENEER  
 FINISH.

6" STONE  
 BASE

#4 REBAR  
 @ 12" E.W.

NEW PIPE SHALL BE LOCATED AT THE  
 TOP OF INVERT TABLE.

NOTE:  
 DEVELOPER/CONTRACTOR IS REQUIRED TO PERFORM VACUUM TESTS  
 IN ACCORDANCE WITH SECTION 02601-MANHOLE, OF THE TOWN OF BRASELTON  
 STANDARD SPECIFICATIONS (LATEST EDITION)

**TOWN OF BRASELTON WATER & SEWER DEPARTMENTS**

JOB TITLE  STANDARD DETAIL	SHEET TITLE  DOGHOUSE MANHOLE	DRN. BY: EMI	REV. NO.	BY	DATE
		CKD BY:			
		APPD. BY:			
		DATE: SEP. 2004			
		DETAIL No. S-5	FILE No. 03033\S-5.dwg	SCALE: N.T.S.	