


PLAN VIEW OF MANHOLE

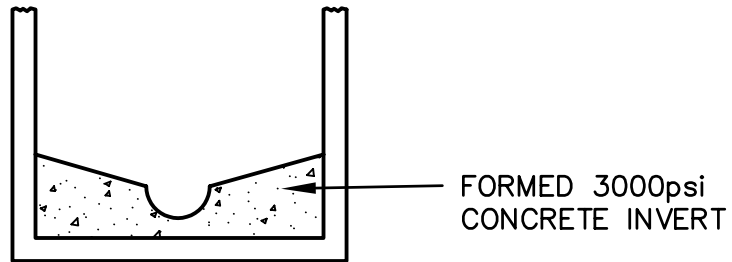

SOLID INVERT

- NOTE: 1. PRECAST INVERTS ARE ACCEPTABLE.  
 2. A 0.2 FOOT DROP ACROSS INVERT REQUIRED.

NOTE:  
 DEVELOPER/CONTRACTOR IS REQUIRED TO PERFORM VACUUM TESTS  
 IN ACCORDANCE WITH SECTION 02601-MANHOLES, OF THE TOWN OF BRASELTON  
 STANDARD SPECIFICATIONS (LATEST EDITION)

**TOWN OF BRASELTON WATER & SEWER DEPARTMENTS**

JOB TITLE  STANDARD DETAIL	SHEET TITLE  <b>INVERT CONSTRUCTION</b>	DRN. BY: EMI	REV. NO.	BY	DATE
		CKD BY:			
		APPD. BY:			
		DATE: SEP. 2004			
		DETAIL No. S-8	FILE No. 03033\S-8.dwg	SCALE: N.T.S.	