


METER BOX TO BE
MODEL # LB75, FLIP-TOP
ENCLOSURE BY HOT BOX
OR APPROVED EQUAL

REDUCED PRESSURE
BACKFLOW PREVENTER;
MODEL 375 BY WILKINS

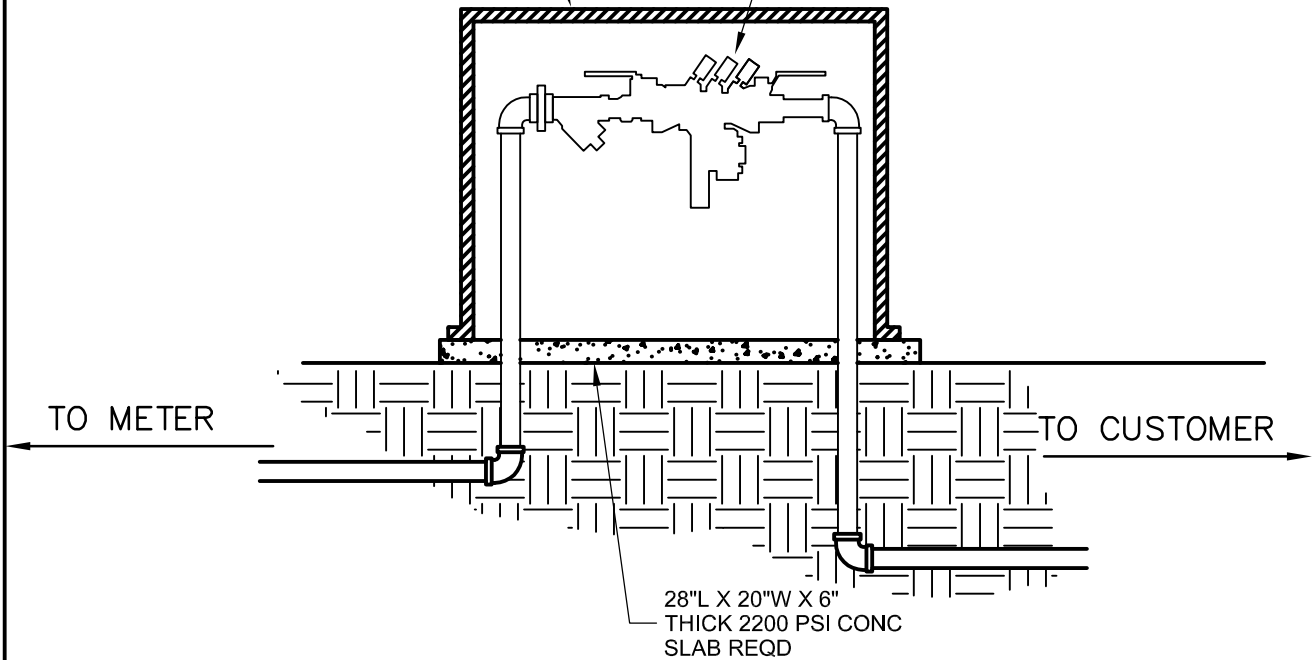

NOTES:

1. THE BACKFLOW PREVENTER ASSEMBLY SHALL BE OF THE REDUCED PRESSURE ZONE TYPE.
2. SHUT-OFF VALVE W/DRAIN TO BE INSTALLED IN METER BOX, W/ 2 C.F. CRUSHED STONE UNDERNEATH
3. ALL PIPES AND FITTINGS 2" THROUGH 4" SHALL BE BRASS.
ALL PIPE AND FITTINGS LARGER THAN 4" SHALL BE D.I.P. CL 350 MIN.

TOWN OF BRASELTON WATER & SEWER DEPARTMENTS

JOB TITLE STANDARD DETAIL	SHEET TITLE RPZ BACKFLOW PREVENTER	DRN. BY: EMI	REV. NO.	BY	DATE
		CKD BY:			
		APPD. BY:			
		DATE: SEP. 2004			
		DETAIL No. W-19	FILE No. 03033\W-19.dwg	SCALE: N.T.S.	