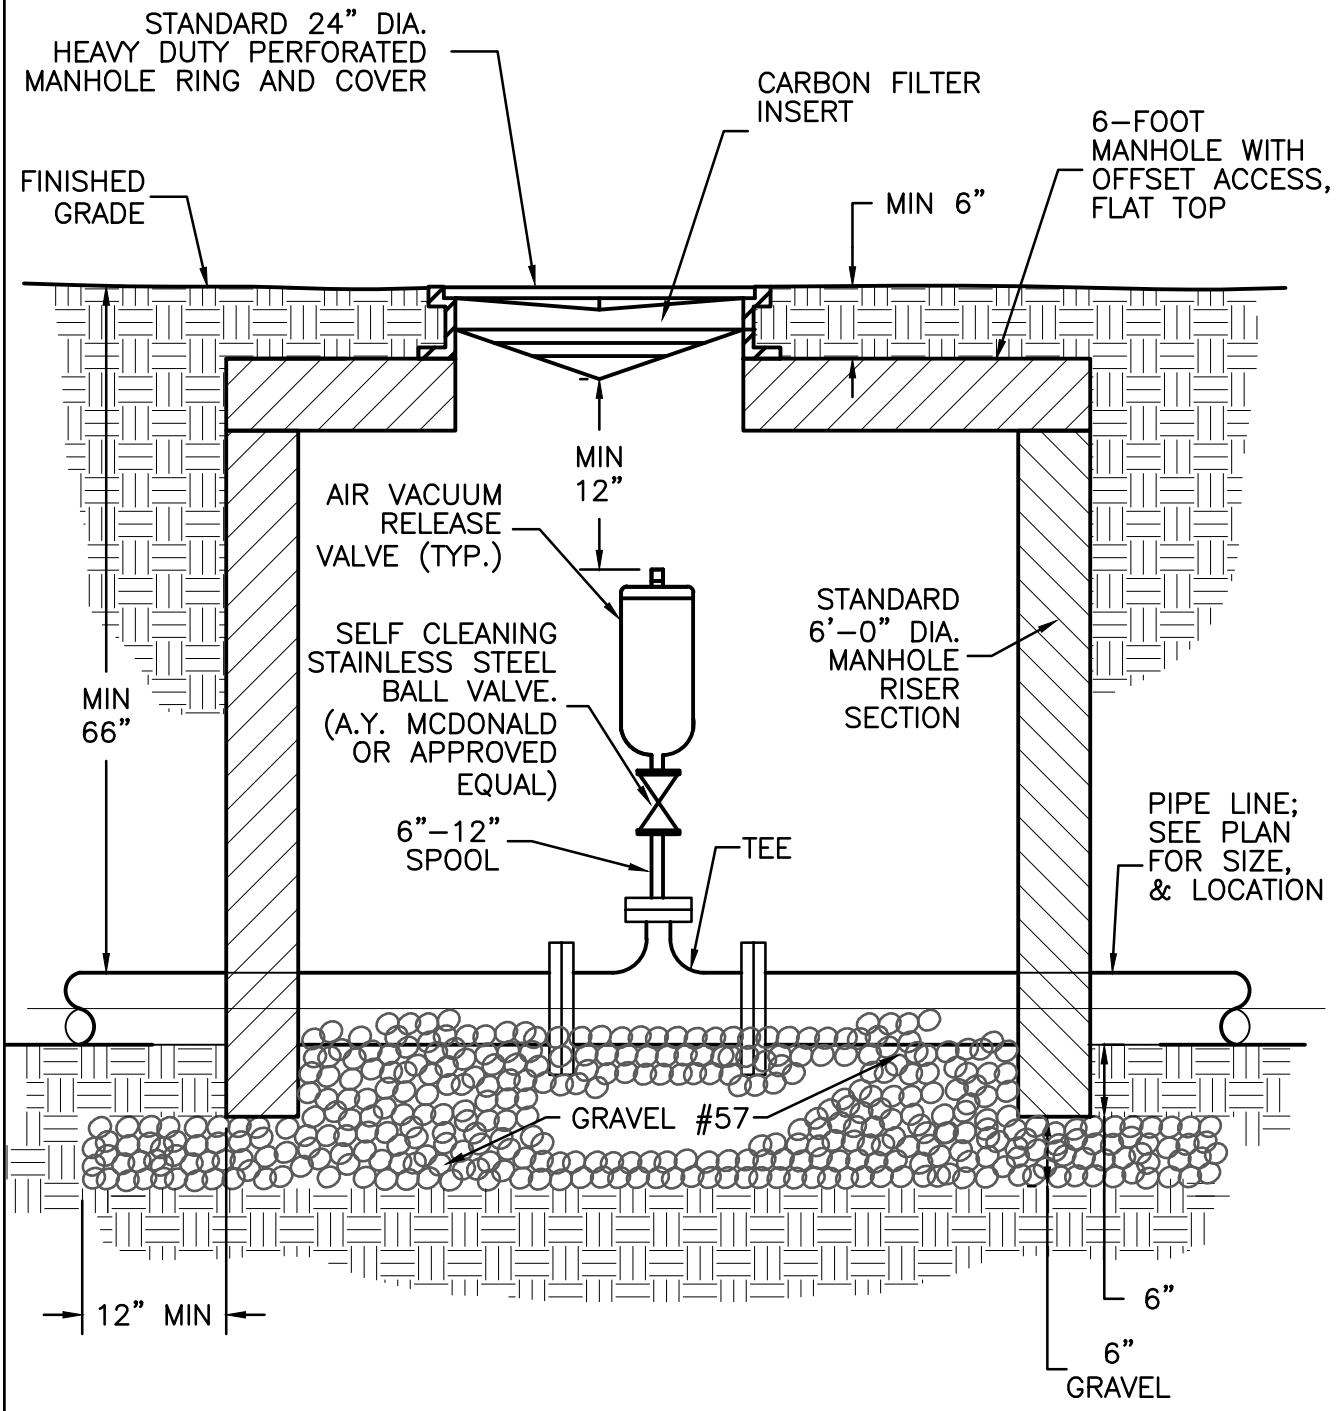

NOTE

1. SEE SPECIFICATIONS SECTION 02732 FOR TYPE AND SIZE OF AIR/VACUUM VALVE FOR SEWER FORCE MAINS.
2. CARBON FILTER INSERT SHALL BE "SWEETSTREET" MANHOLE ODOR CONTROL MODULE BY CONTINENTAL CARBON GROUP.

TOWN OF BRASELTON WATER & SEWER DEPARTMENTS

JOB TITLE	SHEET TITLE	DRN. BY: EMI	REV. NO.	BY	DATE
STANDARD DETAIL	**AIR/VACUUM RELEASE VALVE**	CKD BY:	A	EMI	6/1/18
		APPD. BY:			
		DATE: SEP. 2004			
	DETAIL No. PS-10	FILE No. 03033\PS-10.dwg	SCALE: N.T.S.		