

TOWN OF BRASELTON WATER & SEWER DEPARTMENTS


JOB TITLE
STANDARD DETAIL

SHEET TITLE
LIFT STATION
YARD HYDRANT

DETAIL No. PS-8

DRN. BY: EMI
CKD BY:
APPD. BY:
DATE: SEP. 2004
FILE No. 030331PS-8.dwg

REV. NO. BY DATE
A EMI 05/22/18
SCALE: N.T.S.

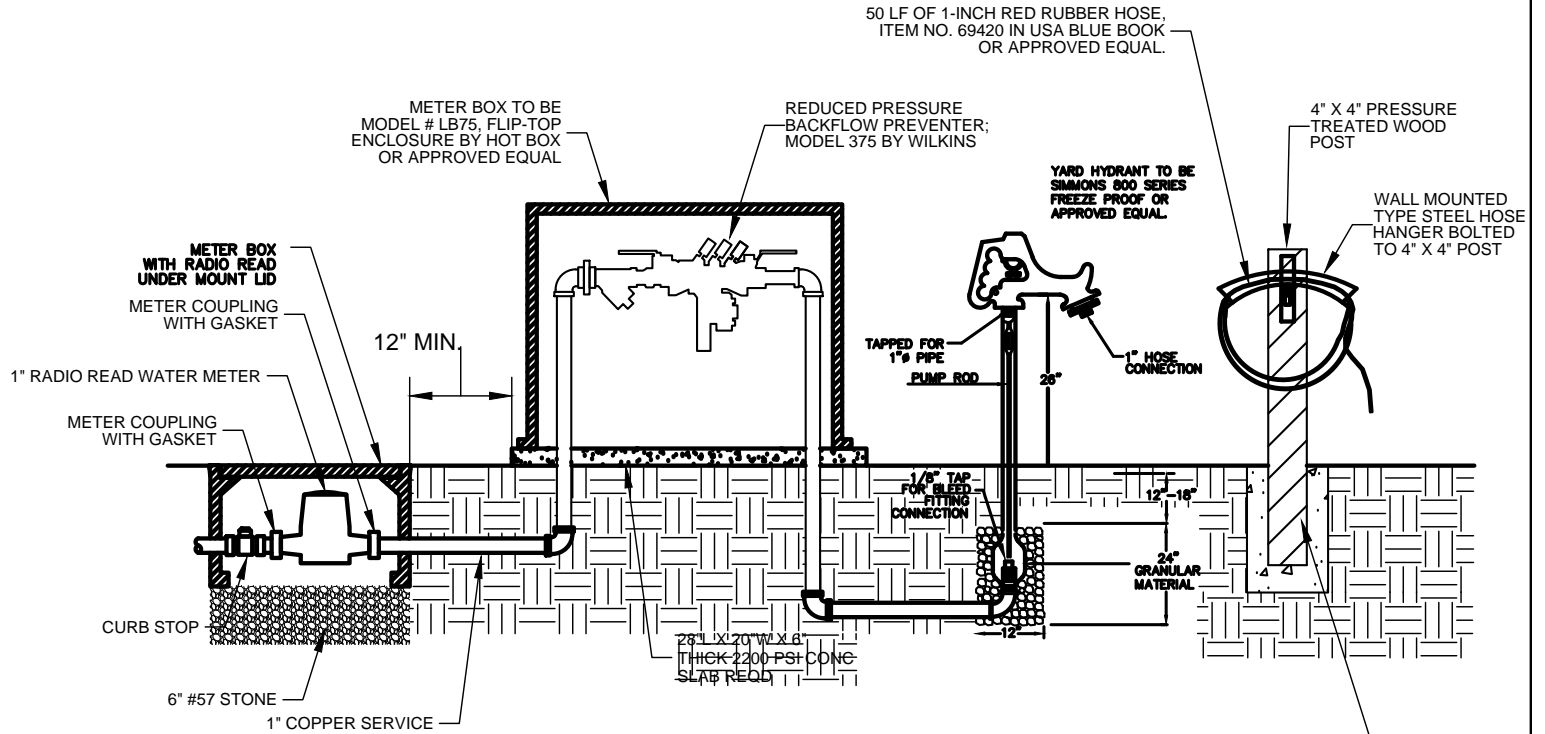

NOTE:

1. TOP OF METER MUST BE A MINIMUM OF 12" FROM THE TOP OF THE METER BOX.
2. CONTRACTOR SHALL PROVIDE 2 EACH 25 LF 1" Ø RUBBER HOSE SECTION AT LIFT STATION

MOUNT POST
18" DEEP
IN CONCRETE