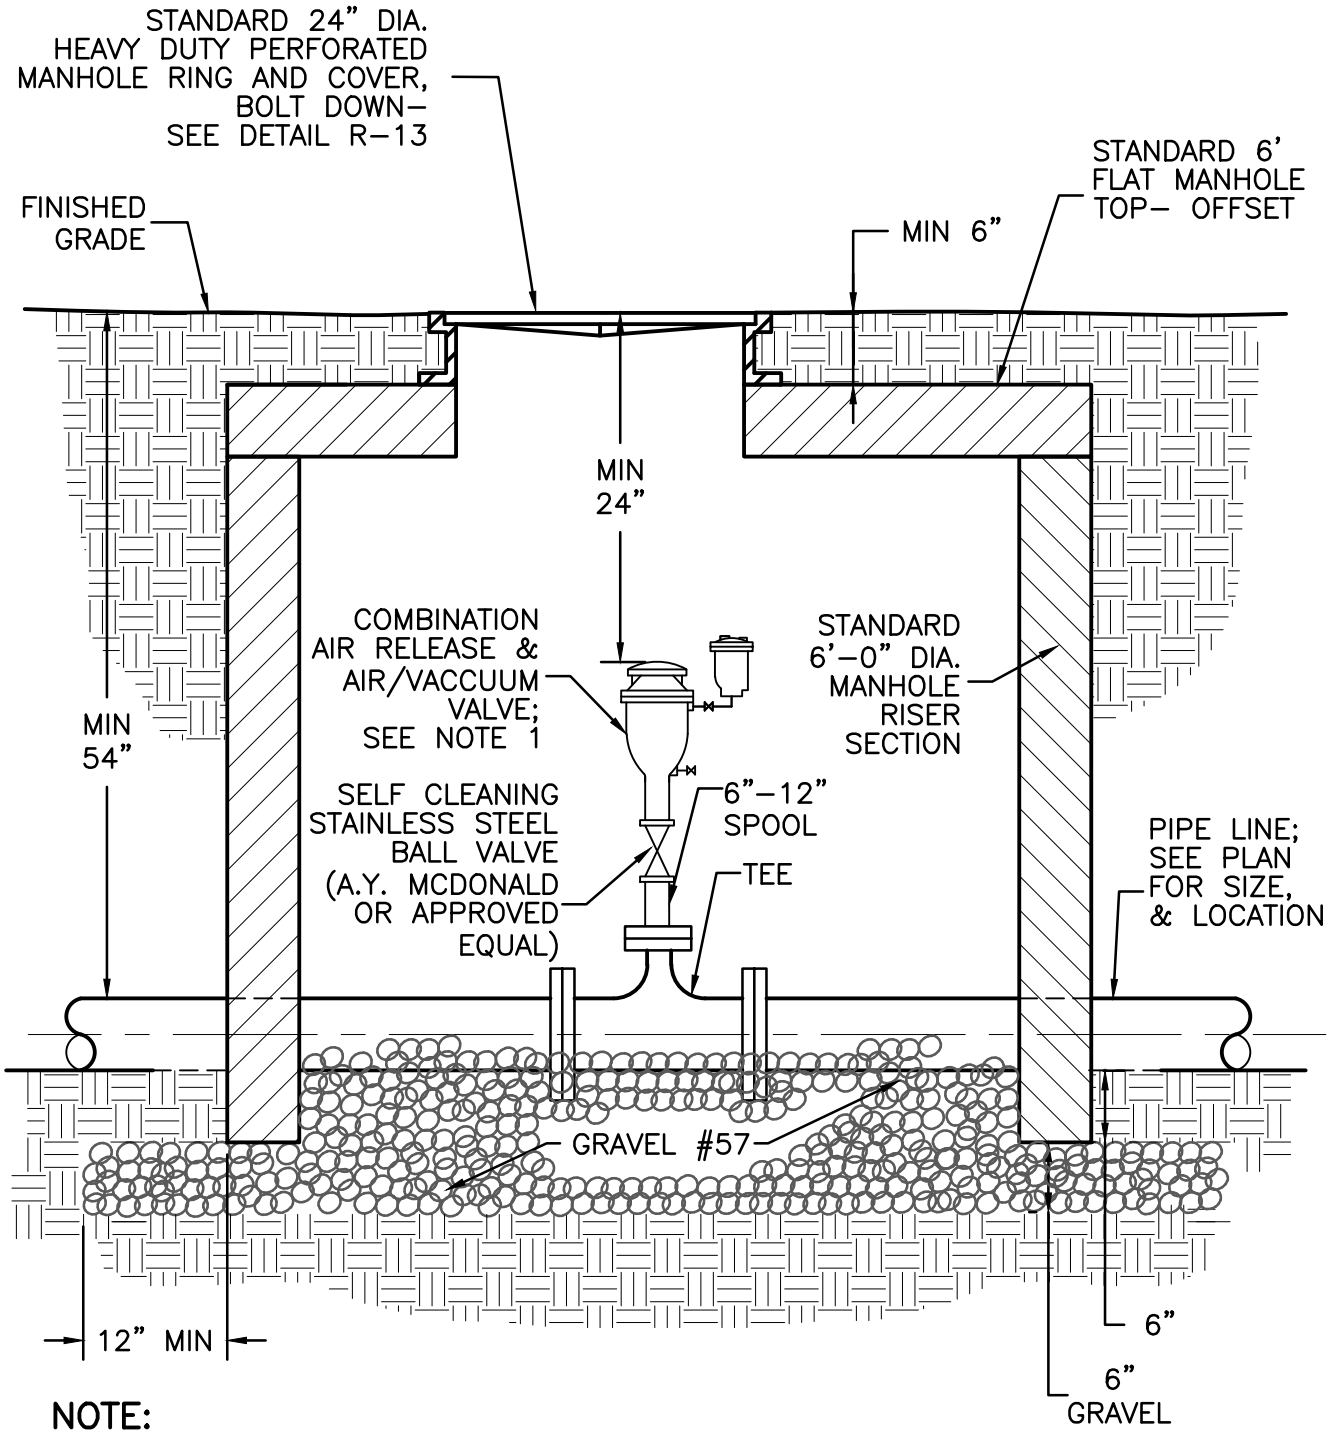

NOTE:

1. SEE SPECIFICATIONS SECTIONS 02661 FOR TYPE AND SIZE OF AIR RELEASE VALVE AND AIR\VACUUM VALVE.
2. ALL PIPE & VALVES SHALL BE PAINTED PANTONE PURPLE 522 W/ A SUNLIGHT STABLE PIGMENT

TOWN OF BRASELTON WATER & SEWER DEPARTMENTS

JOB TITLE	SHEET TITLE	DRN. BY: EMI	REV. NO.	BY	DATE
STANDARD DETAIL	**REUSE COMBINATION AIR RELEASE AND AIR VACUUM VALVE**	CKD BY:	A	EMI	7/30/18
		APPD. BY:			
		DATE: JUNE 2018			
	DETAIL No. R-12	FILE No. 03033\R-12.dwg	SCALE: N.T.S.		