


**NOTE:**

1. TOP OF METER MUST BE A MINIMUM OF 12" FROM THE TOP OF THE METER BOX.
2. CURB STOP SHALL BE LOCATED SO VALVE IS ACCESSIBLE AND CAN BE OPERATED.
3. SEE SPECIFICATION 02666 FOR SPECIFIC REQUIREMENTS.
4. METERS SHALL BE SET BETWEEN SIDEWALKS AND HOUSE, AND IN BACK OF 10' UTILITY EASEMENTS WHERE APPLICABLE .
5. METER BOX SHALL BE PANTONE PURPLE AND READ "RECLAIMED WATER" BY MANUFACTURER
6. CORPORATION STOP AND CURB STOP SHALL BE STAMPED WITH THE WORDS "RECLAIMED WATER" BY MANUFACTURER.

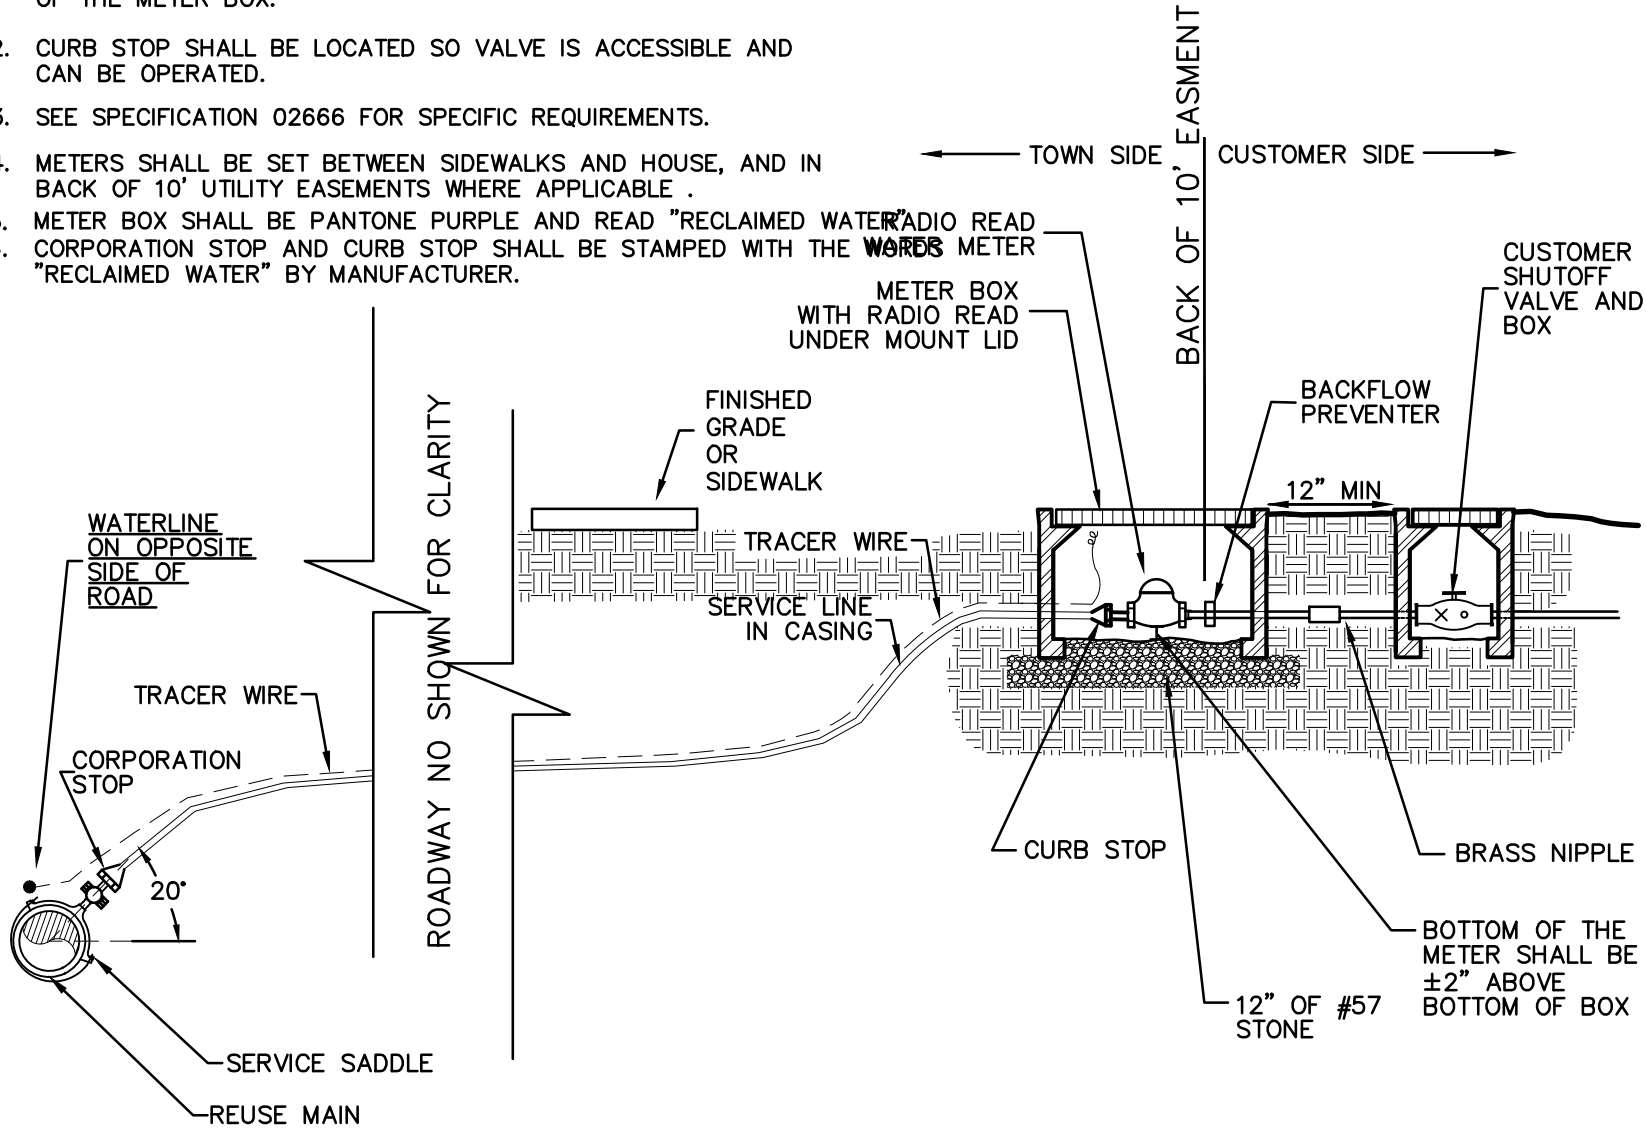

**TOWN OF BRASELTON WATER & SEWER DEPARTMENTS**

JOB TITLE

STANDARD DETAIL

SHEET TITLE  
 REUSE 1 - INCH AND SMALLER  
 LONG SIDE SERVICE CONNECTION  
 (WITH METER)

DRN. BY: EMI

CKD BY:

APPD. BY:

DATE: MARCH 2004

FILE No. 030331R-14.dwg

DATE

02/07/19

REV. NO.

A

BY

EMI

SCALE: N.T.S.