


NOTES:

1. FIRST SECTION OF PROPOSED SEWER LINE SHALL BE ISOLATED FROM THE REST OF THE PROPOSED SYSTEM. THE FIRST MANHOLE OF THE PROPOSED SYSTEM SHALL BE USED TO PUMP OUT ANY INFLOW/ INFILTRATION, MUD, ETC., THAT ENTERED DURING CONSTRUCTION. THE PLUGS SHALL NOT BE REMOVED UNTIL APPROVAL OF PROPOSED SEWER SYSTEM BY THE TOWN OF BRASELTON.

2. NEW/PROPOSED SEWER SYSTEM SHALL NOT BE CONNECTED TO EXISTING SEWER SYSTEM UNTIL APPROVED BY TOWN OF BRASELTON. ALL NEW PIPING SHALL BE CLEANED AND TESTED PER TOWN OF BRASELTON SPECIFICATINS(LATEST EDITION).

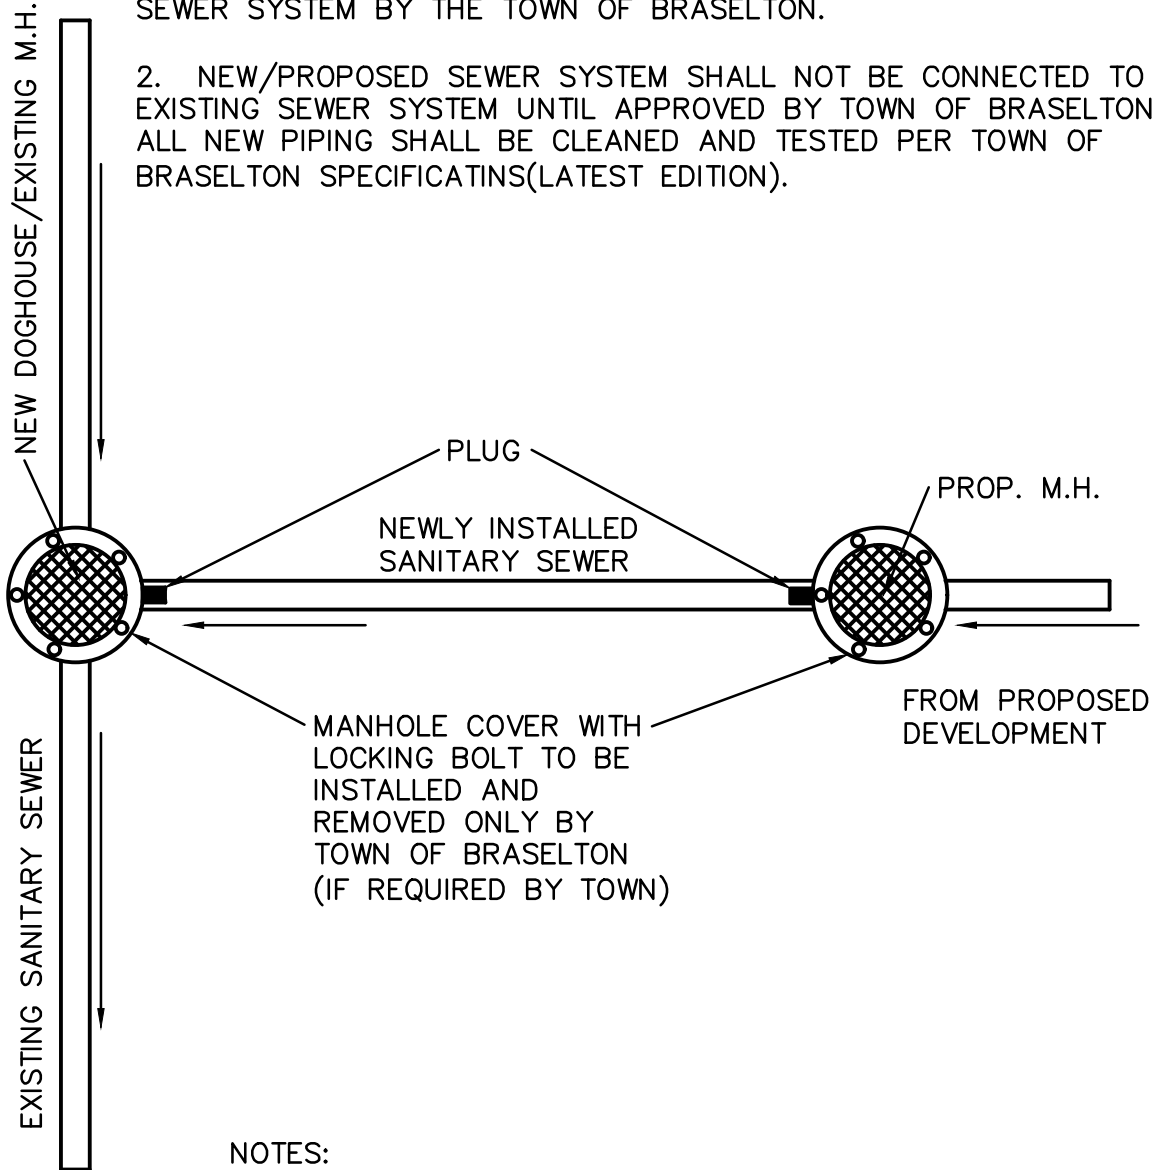

NOTES:

1. TEST MANHOLE REQUIRED FOR COMMERCIAL & INDUSTRIAL DEVELOPMENT.
2. LOCATION TO BE APPROVED BY TOWN ENGINEER.

**TOWN OF BRASELTON WATER & SEWER DEPARTMENTS**

JOB TITLE  STANDARD DETAIL	SHEET TITLE  <b>PLUG LOCATION DETAIL</b>	DRN. BY: EMI	REV. NO.	BY	DATE
		CKD BY:	A	EMI	03/01/18
		APPD. BY:			
		DATE: SEP. 2004			
		DETAIL No. S-32	FILE No. 03033\S-32.dwg	SCALE: N.T.S.	