


NOTE:

1. TOP OF METER MUST BE A MINIMUM OF 12" FROM THE TOP OF THE METER BOX.
2. CURB STOP SHALL BE LOCATED SO VALVE IS ACCESSIBLE AND CAN BE OPERATED.
3. SEE SPECIFICATION 02665 FOR SPECIFIC REQUIREMENTS.
4. METERS SHALL BE SET BETWEEN SIDEWALKS AND HOUSE, AND IN BACK OF 10' UTILITY EASEMENTS WHERE APPLICABLE .

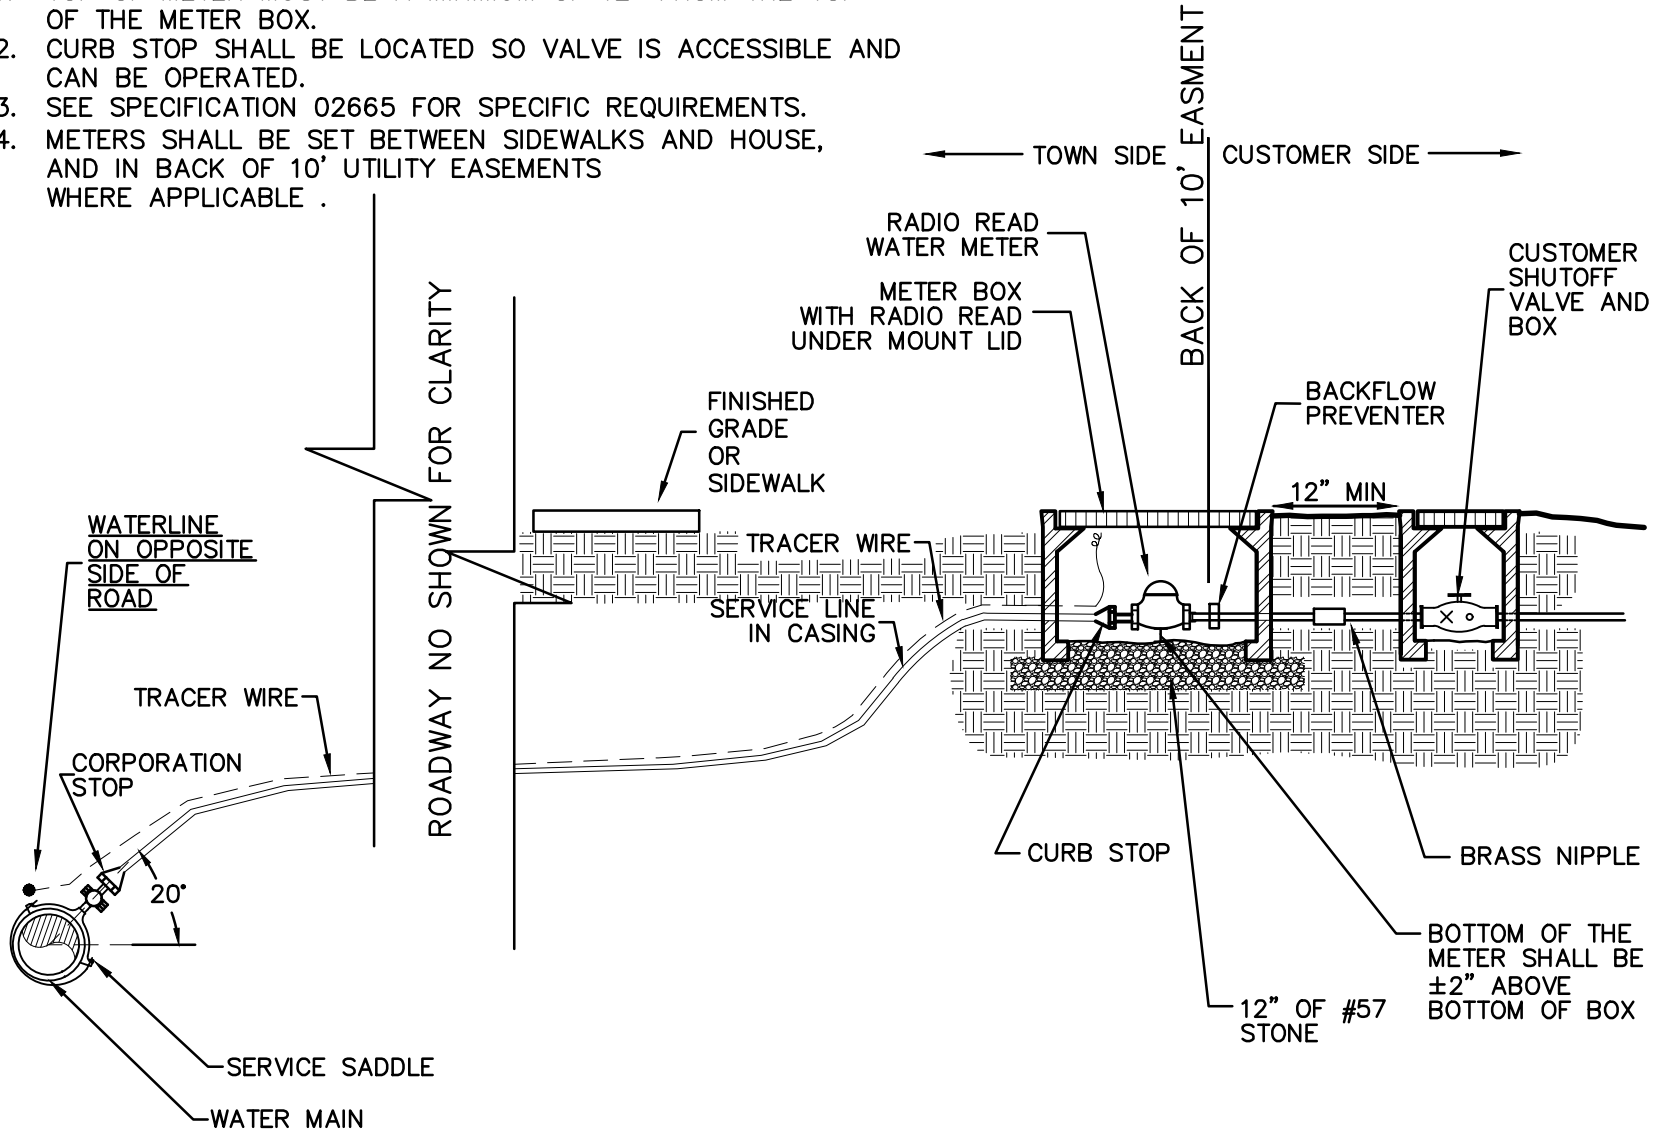

TOWN OF BRASELTON WATER & SEWER DEPARTMENTS

JOB TITLE STANDARD DETAIL	SHEET TITLE 1-INCH AND SMALLER LONG SIDE SERVICE CONNECTION (WITH METER)		DRN. BY: EMI	REV. NO. A	BY: EMI	DATE: 02/07/19
	DETAIL No. W-14		APPD. BY:	DATE: MARCH 2004	FILE No. 03033W-14.dwg	SCALE: N.T.S.